


SuperLOTIS TELESCOPE

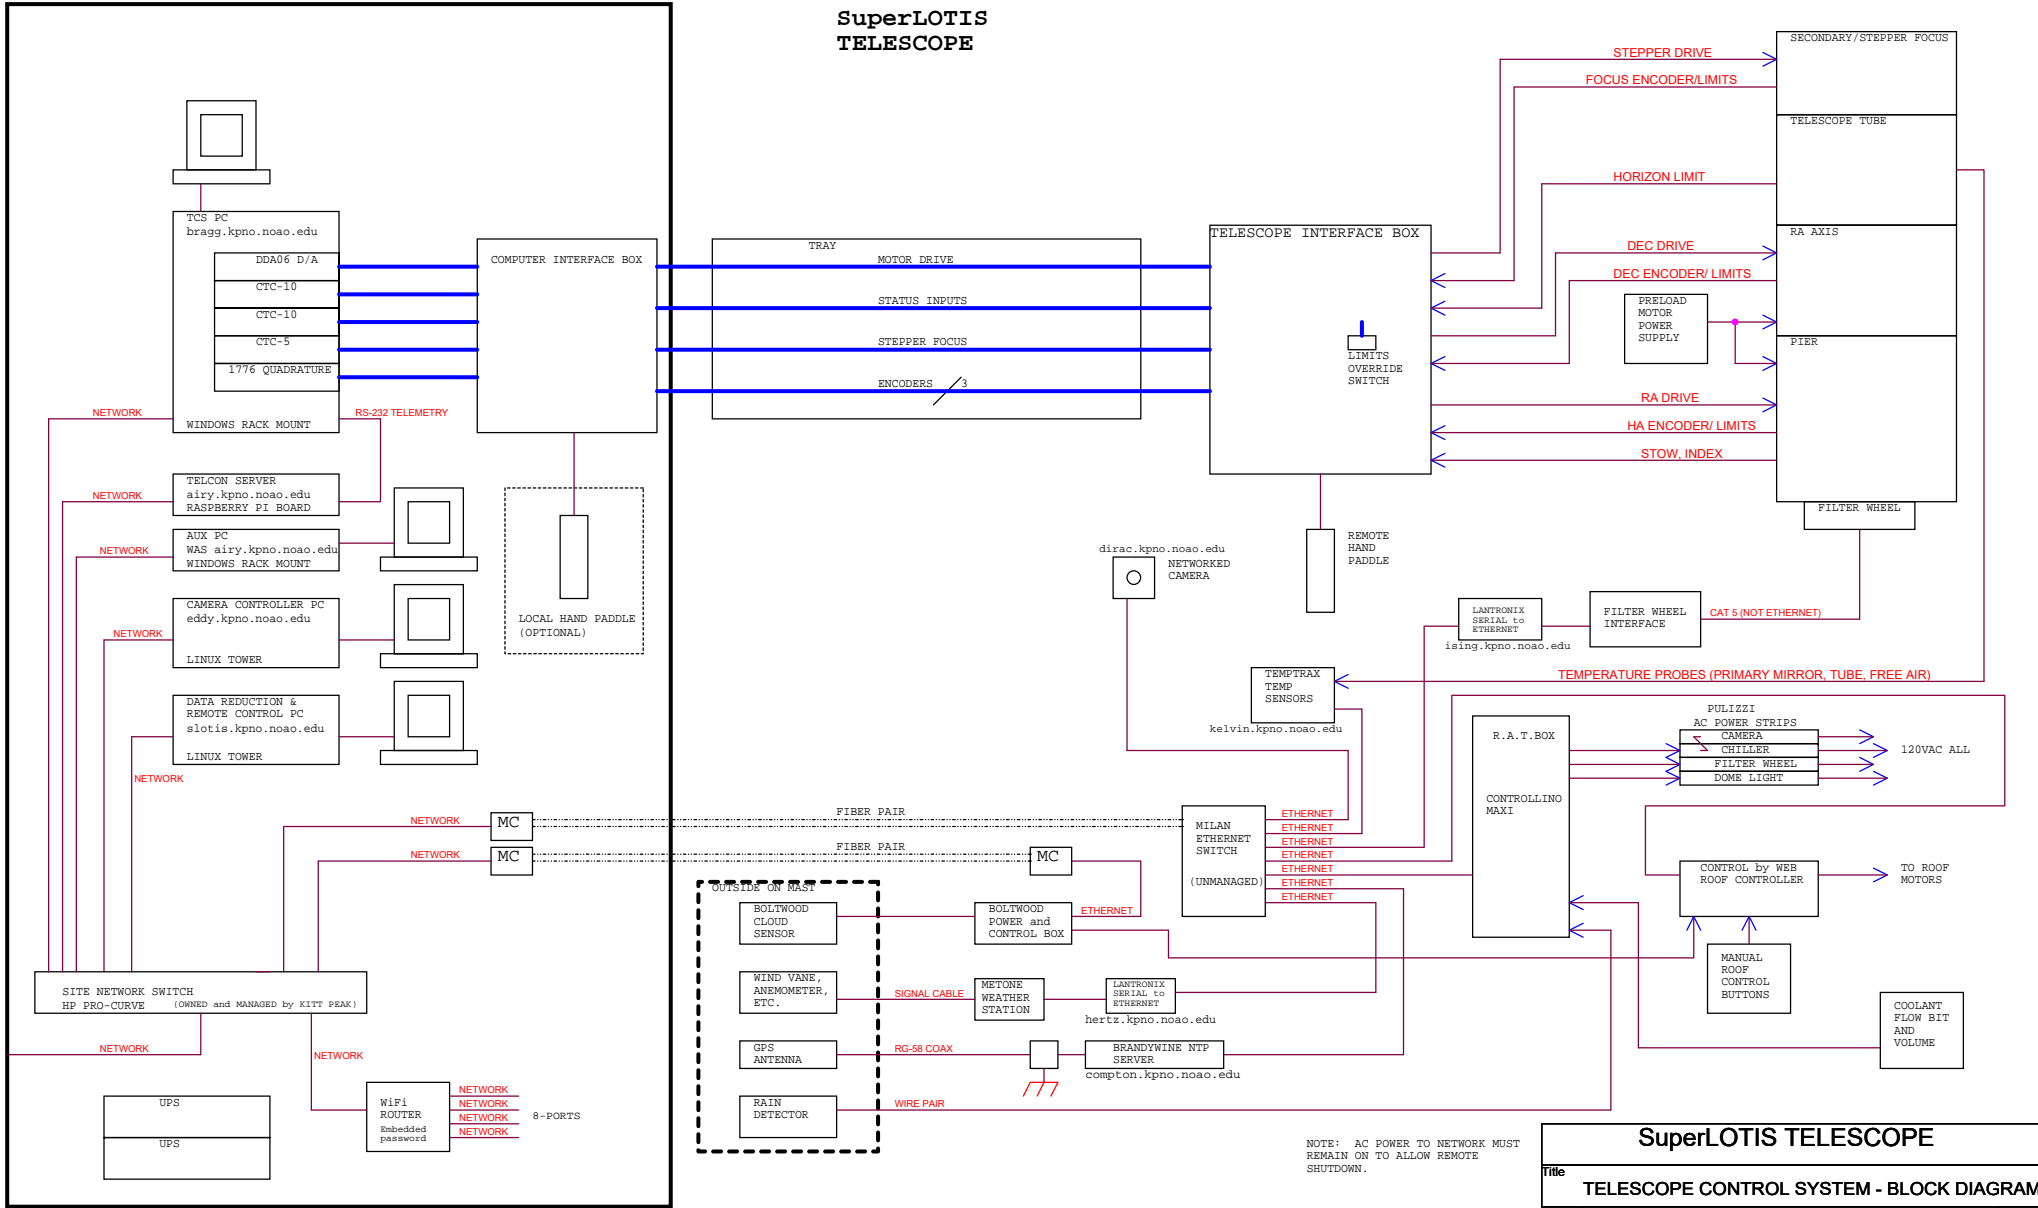

NOTE: AC POWER TO NETWORK MUST REMAIN ON TO ALLOW REMOTE SHUTDOWN.

| SuperLOTIS TELESCOPE | | | |
|--|-------------------------|-------|--------|
| Title | | | |
| TELESCOPE CONTROL SYSTEM - BLOCK DIAGRAM | | | |
| Size | Document Number | Rev | |
| B | KPSL_TCS_block.pdf | A | |
| Date: | Thursday, July 06, 2017 | Sheet | 1 of 1 |